


-15kV TOF: -9181 v
 -3.6kV MCP: -3364 v
 -2.4kV MCP: -1784 v
 Input Cur: 320 ma
 RPA max: 237 v
 Mirror max: 238 v

Wed Dec 20 10:34:11 2006

TIDE Direct Events

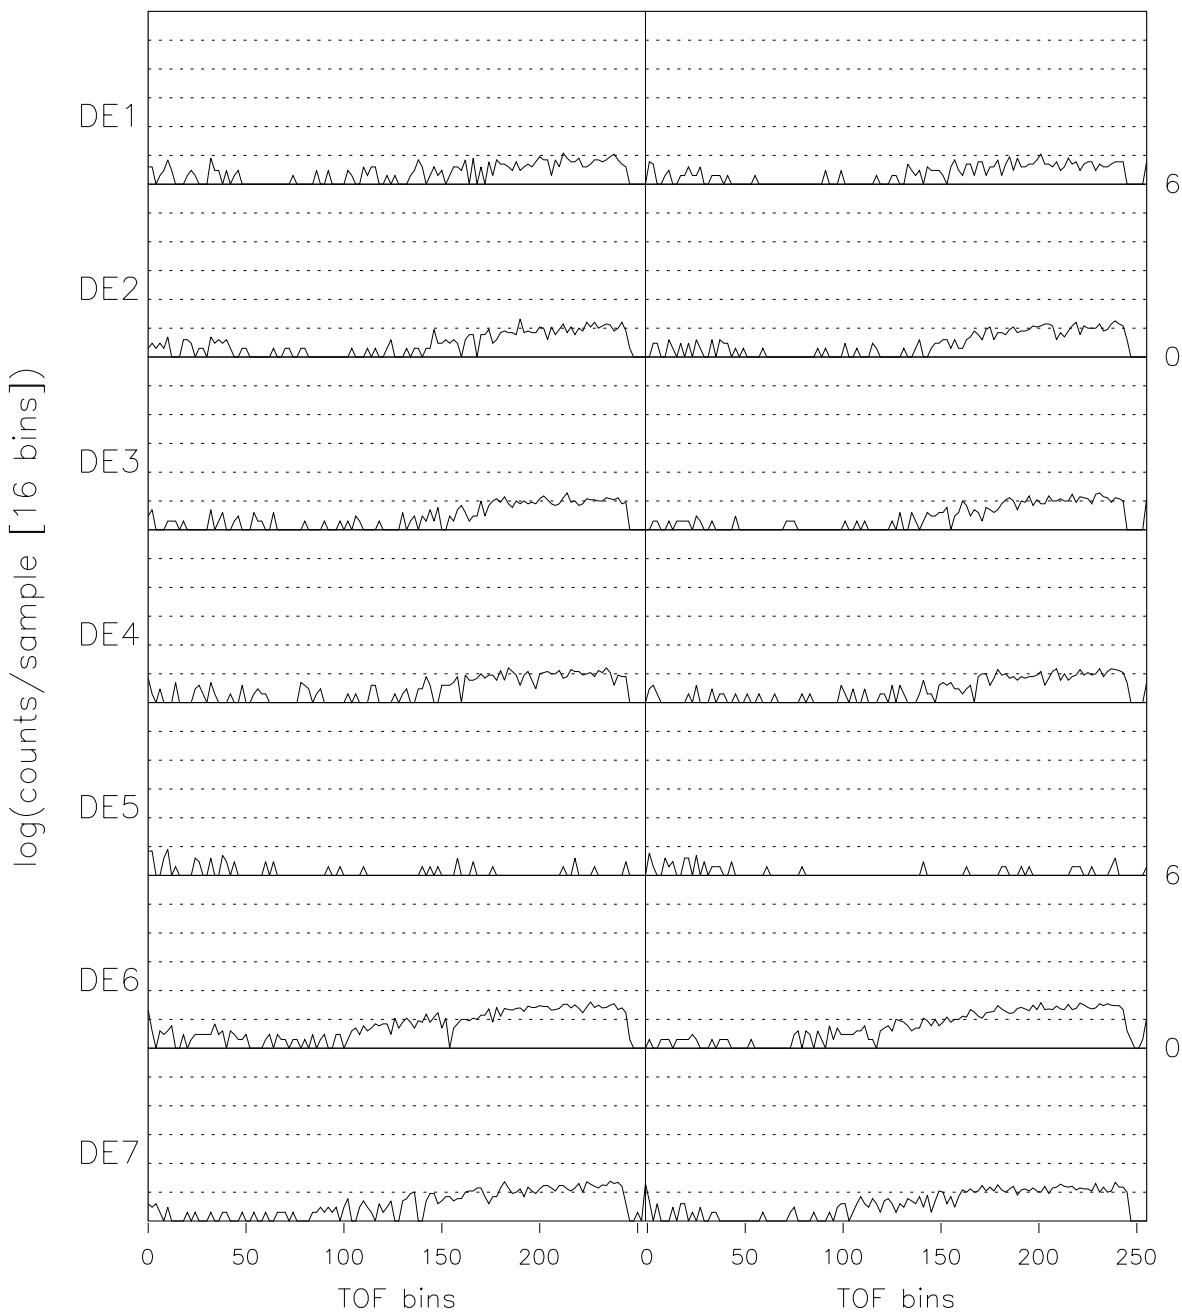

reported: 12-20-06 16:15:07 UT

reported: 12-20-06 16:18:19 UT

file: /export/data/tide/nrt/nrt0612201556.lz

-15kV TOF: -9181 v

-3.6kV MCP: -3364 v

-2.4kV MCP: -1784 v

Input Cur: 310 ma

RPA max: 237 v

Mirror max: 238 v